



**Basements and every sleeping room must have at least one window with a minimum net clear opening of 5.7 square feet. The minimum net clear opening height dimension shall be 24 inches. The minimum net clear opening width shall be 20 inches. Grade floor windows may have only 5 square feet of net clear opening.**

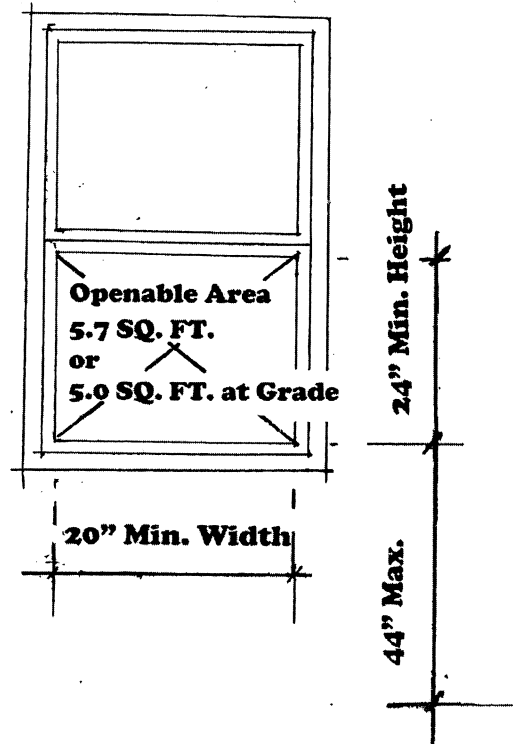


## **EMERGENCY ESCAPE and RESCUE OPENINGS**

### **BASEMENT / BEDROOM WINDOW**

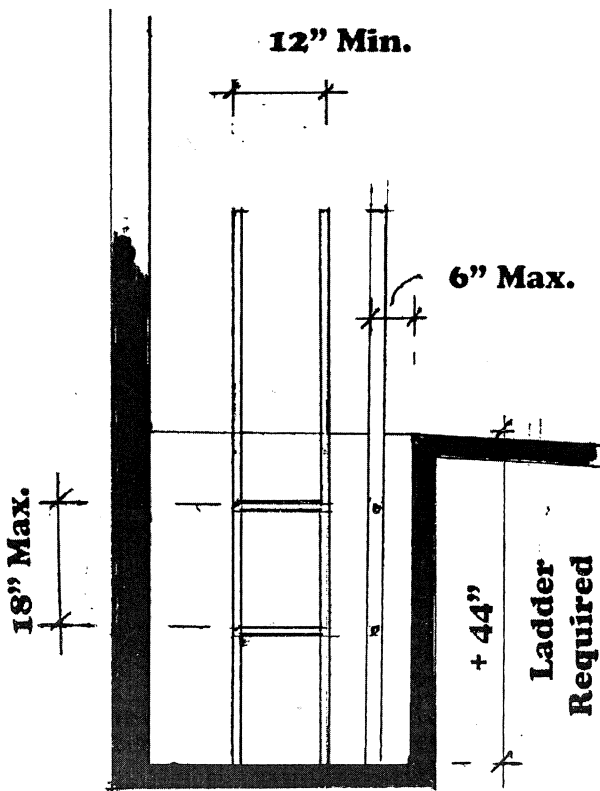

**Section**

**Window Well**

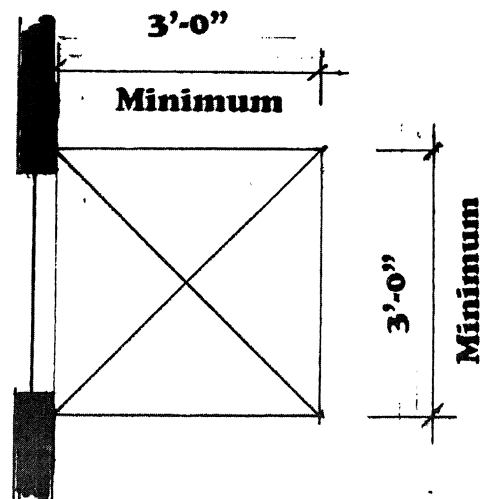

**Plan**