


flood vents

- 1 square inch/1 square foot of floor plan area
- 3" round minimum opening
- minimum of 2 openings
- evenly dispersed around perimeter
- bottom of opening shall be 12" or less above the adjacent ground level

Finish Floor Elevation
(certified by a MD RDP)

Design Flood Elevation
(Obtain from Zoning)

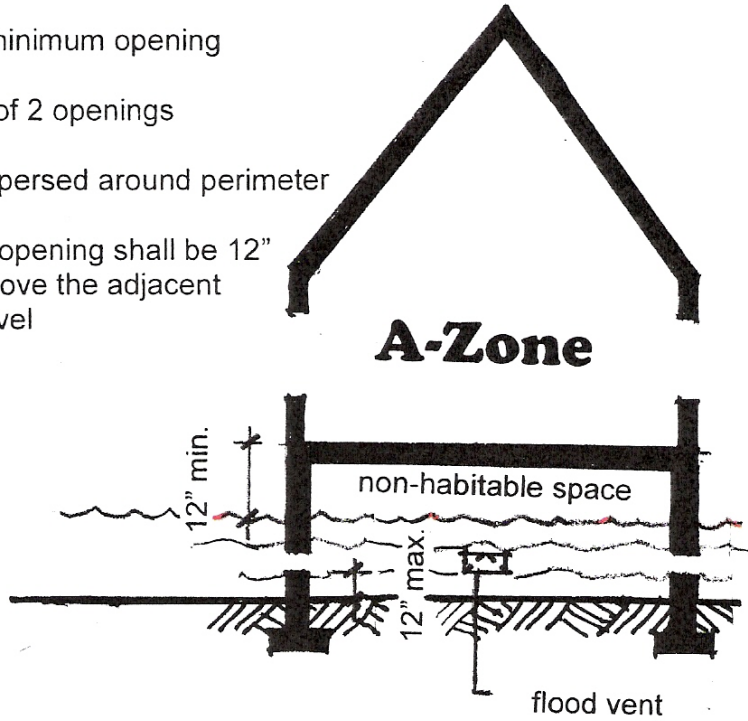


Finish Floor Elevation

Design Flood Elevation

Finish Grade
finish floor, bottom of crawl space must match or be higher than adjacent grade

bldg plans certified by a MD RDP
(registered design professional)

column or pile foundation required

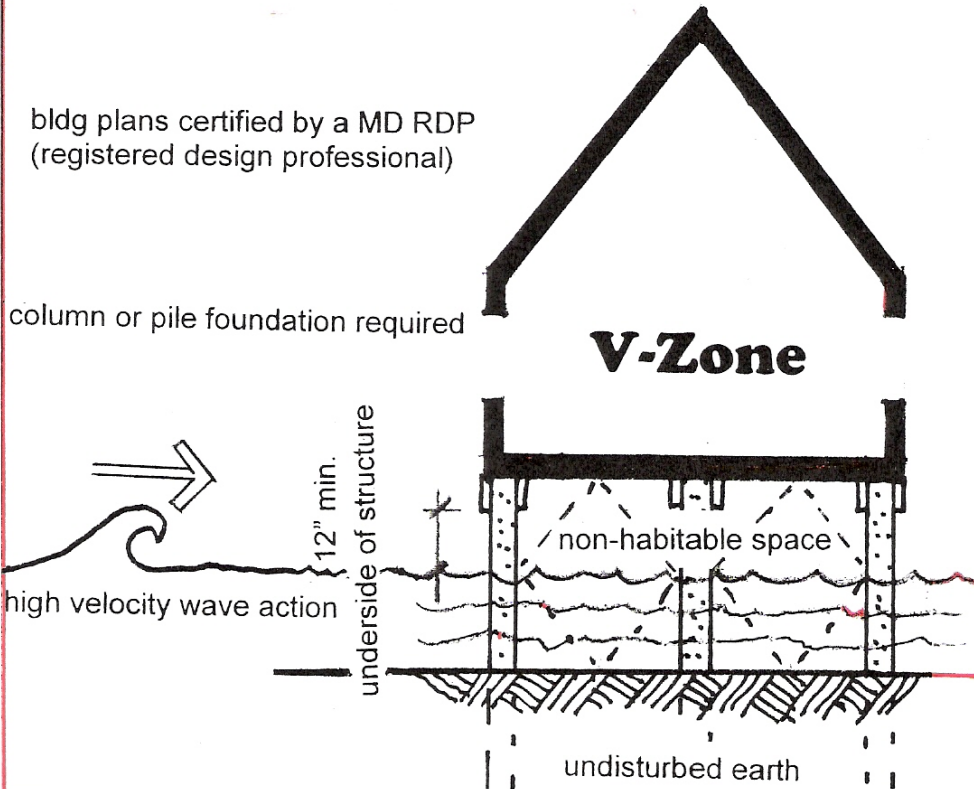

Design Flood Elevation
(Obtain from Zoning)

Finish Floor Elevation
(certified by a MD RDP)

Finish Floor Elevation

break away wall, lattice or screening

Design Flood Elevation

Finish Grade

Flood Zone Design Requirements